

Turbine Dimensionless Coefficients and the Net Head/Flow Rate Characteristic for a Simplified Pico Hydro Power System

Alex Okibe Edeoja^{1*}, Matthew Ekoja¹ and Joshua Sunday Ibrahim¹

¹*Department of Mechanical Engineering, University of Agriculture, Makurdi, Nigeria.*

Authors' contributions

This work was carried out in collaboration between all authors. Author AOE designed the study, performed the general computations, wrote the protocol, managed the literature searches and wrote the first draft of the manuscript. Author JSI supervised the analyses of the study. Author ME participated in the initial study of dimensionless quantities. All authors read and approved the final manuscript.

Article Information

DOI: 10.9734/JERR/2018/v1i119787

Editor(s):

(1) Pierre-Olivier Logerais, Associate Professor, Department of Energy Systems, Université Paris-Est Créteil, France.

Reviewers:

(1) Hüseyin DAL, University of Sakarya, Turkey.
(2) Shashidhar K. Kudari, JNT University, India.

Complete Peer review History: <http://www.sciencedomain.org/review-history/24667>

Original Research Article

Received 25th February 2018

Accepted 6th May 2018

Published 18th May 2018

ABSTRACT

The basic operational parameters of a simplified pico-hydropower system with provision for water recycling were investigated. Five simplified turbine of runner diameters 0.45, 0.40, 0.35, 0.30 and 0.25 m were designed, locally fabricated, and tested in conjunction with five PVC pipes of diameters 0.0762, 0.0635, 0.0508, 0.0445 and 0.0381 m as penstocks. Five simple nozzles of area ratios 1.0, 0.8, 0.6, 0.4 and 0.2 were fabricated for each penstock diameter. The turbines were successively mounted at the foot of an overhead reservoir such that the effective vertical height from the outlet of the reservoir to the plane of the turbine shaft was 6.95 m. A 1.11 kW electric pump was used to recycle the water downstream of the turbine back to the overhead reservoir. The mean maximum and minimum rotational speeds of the shaft of each turbine were measured for each penstock diameter and nozzle area ratio, and the volumes of water displaced in the reservoirs were also monitored. These measured data were used to compute shaft power and system volumetric flow rate for each operation. Dimensionless flow, head and power coefficients, and specific speed were

*Corresponding author: E-mail: aoedeoja@gmail.com;

computed and functional characteristics relating them developed. This standard procedure generally used for the analysis of geometrically similar hydraulic machines have been applied to this system and the results obtained will be invaluable in development of the system into a simple, environmentally friendly and decentralized small power generation system that could potentially contribute positively to the energy mix in Nigeria. The possibility of scaling the system to accommodate larger turbine and penstock diameters, and as a result higher capacity alternators exist and is a target for future developments.

Keywords: Decentralized power; environmentally friendly; net head/flow rate characteristic; nozzle area ratio; penstock diameter; Turbine dimensionless coefficients.

1. INTRODUCTION

Though energy plays a very crucial role in economic development of a nation, access to it is very minimal in many developing countries as a result of a mix of several factors [1-8]. In Nigeria, many of the functional energy supply systems operate below installed capacity, and are frequently susceptible to limitations resulting from human and natural causes. Moreover, many of the systems are large, centralized and utilize energy resources that have some adverse impacts on the environment. Furthermore, several of the energy resources in use are depleting so that sustainability is not guaranteed [9-15]. Exploration and transportation of new deposits also compound the negative effects on the environment such as oil spillage while escalating friction in the host communities [16-18].

Consequently, there is growing interests in and clamor for the use of renewable energy sources, as well as in smarter, smaller and more decentralized energy systems which will utilize these renewable sources and the existing conventional ones more efficiently [19-31]. These systems convey more control to the end user creating more sense of responsibility with regard to the maintenance and security of the system, especially with the prevalent activities of saboteurs of diverse motivations. Also, the development of systems that generate the required power at or close to the point of application has the potential of mitigating attacks on supply structures particular with the growing regional restiveness in developing countries like Nigeria. Such systems do not require maintenance and protection of the supply structure [17,32-44].

Hydropower has numerous advantages over other renewable energy sources but the large schemes which are generally predominantly in use in Nigeria and other developing countries, also pose a lot of environmental problems

[45-55]. These include harm to aquatic animals and habitat, possibility of enhancement of disease to the neighboring communities, as well as displacement of settlements. There is also growing evidence of emissions from the reservoirs. Large to small hydro which depend on flowing water sources are affected by the hydrological cycle (seasonal fluctuation) which translates to blackouts and significant power outages at some periods of the year. Also, debris and silt blockages of turbine passages often arise which also affect power supply. Evidence also exist of disease enhancement in the region of hydropower reservoirs [56-66].

There is therefore increased interest in very small hydro and pumped storage hydro [67-77]. Pico-hydro power provides a very good option because it suits the general characteristics of smarter, smaller and decentralized systems, and can be utilized in locations where larger conventional systems cannot be optimally located. For instance, it is now a very useful option in the Asian developing countries where the topographies are natural barriers to the uptake of conventional grid-connected energy systems [78-90]. However, it has been verified that seasonal fluctuations of water levels also affect the operation of the conventional Pico-hydro schemes. Low water levels do not allow optimal operation while very high ones can sweep the units away [91-98].

There are many sites suitable for Pico-hydro development in Nigeria as in many other African countries but deliberate focus has not been given to its development [17]. For instance, no direct attention is paid to Pico-hydro systems development in the apparently aggressive efforts of Nigeria's Federal Government to revitalize the hydropower sector [14,44]. Hence, the development of a Pico-hydro system that may not require naturally flowing water becomes necessary. Developing any means of applying the advantages of hydropower while greatly minimizing the operational and

natural shortcomings will be a step in the right direction.

A simplified Pico-hydro system that is a variant of the pumped hydro scheme which could be operated where there is no naturally flowing water by utilizing overhead water storage is currently being developed in University of Agriculture, Makurdi, Nigeria for more than four years now. Such a system will eliminate several of the issues that conventional hydropower systems have to contend with while retaining its substantial advantage as a system for power supply like current best practices in renewable energy systems. It will be decentralized thereby conceding control to the user and reducing the risk of sabotage. The limitation imposed by seasonal variations of water levels on conventional Pico-hydro systems will be eliminated as well [99-107]. The current aspect of the work looks at the prospects for acceptability of this system as a simple contribution to the energy mix in Nigeria. It focusses on the generation of information that will come in handy for future developments of the system.

For all hydraulic machines, it is customary to develop a net head and flow rate characteristic that governs the performance. In conventional hydropower practice, the flow rate and gross head data are collected from the site with the net head obtained from the gross head. This characteristic is therefore invaluable in predicting or fixing the net head and the flow rate for sites where hydropower systems will be installed [108-114]. For this system under development, these parameters are not site-dependent but system components-dependent. This means that for this system, the net head and flow rate characteristic will be useful in selecting system components in terms of basic dimensions. In other words, they can be fixed and then used to determine the configurations of the system component.

Furthermore, dimensionless analysis of hydraulic machines yields dimensionless coefficients that are very useful in summarizing the performance of dimensionally similar machines. It is quite useful to have a dimensionless group involving shaft rotational speed, flow rate, head and power with the diameter of the machine. This makes the group independent of the machine size. This can be done by manipulating the other dimensionless groups for the machine to obtain a new dimensionless coefficient. Hence, the coefficients can be used for scaling of system components such as turbine and penstock diameters in order

to get a desired power output. The dimensionless coefficients include flow (K_Q), head (K_H) and power (K_P) coefficients as well as specific speed (K_S). For maximum efficiency, there are generally only one set of values for them [108-110,115]. The functional relationships between these coefficients are experimentally determinable and constitute a set of performance characteristics representing the whole family of geometrically similar machines. They are identical for all such machines if factors such as Reynold's number, Mach number and relative roughness are the same. For all machines belonging to the same family, and operating under similar conditions the dimensionless coefficients are the same at corresponding points of their characteristics. Hence, according to [110] the similarity laws governing the relationships between such corresponding points may be written as in the equations below.

$$Q \propto ND^3 \quad (1)$$

$$gH \propto N^2D^2 \quad (2)$$

$$P \propto \rho N^3D^5 \quad (3)$$

This work presents the net head and flow rate characteristics as well as the dimensionless flow, head, power and specific speed coefficients of the simple Pico hydropower system undergoing development. The results will be useful for the continued development aimed at arriving at an implementable status for rural and urban locations in Nigeria in a bid to contribute positively to the sustainable energy mix. There will eventually be need to install various capacities for various users depending on several factors ranging from cost to location and the application. These results will come in handy then.

2. MATERIALS AND METHODS

PVC pressure pipes of diameters 0.0762, 0.0635, 0.0508, 0.0445 and 0.0381 m were selected as penstocks. According to [116] and [117] PVC is lighter, has better friction characteristics and is cheaper than steel apart from the subjective factor of being more readily available in the required sizes. Their pressure characteristics are similar. The associated frictional losses were estimated using the equations suggested by [118] for pipes of diameter greater than 5 cm and flow velocity below 3 m/s. An average value of $C = 137.5$ was used in this study because it lies between 135 and 140 for plastic pipes.

The turbulence losses (H_t) were estimated with values for the coefficients K for pipe entry, gate valve and 90° elbow obtained from [110] as 0.5, 0.25 and 0.9 respectively. For change in penstock dimensions, K values were obtained using the equation given by [118]. The K values for the reduction of penstock from 0.0762 to 0.0635 m, 0.0635 to 0.0508 m, 0.0508 to 0.0445 m and 0.0445 to 0.0381 m were then computed. H_t values were then computed with only the valve, elbow and entry coefficients applied to the largest diameter penstock. The contraction coefficients were then successively added as the penstock sizes were reduced. The net head available was then computed.

The design procedure for a single nozzle Pelton turbine resembling a propeller turbine was adopted. This is because a propeller turbine allows for the generators to be directly driven thereby avoiding transmissions and the attendant losses. Also, the runners had a relatively lower number of fixed blades, therefore simplifying the manufacturing process and reducing the potential for inconsistent blade construction and orientation. Furthermore, the Pelton turbine can be mounted vertically or horizontally [119-128]. A simple V-shape blade with about 60° included angle was adopted. The approach presented by [129] was used in this work in order to obtain the base turbine runner diameters which were then scaled upwards to enhance manufacturability and application for the study [130,131]. The values of the system flow rate computed were substituted into the expressions for the turbine parameters given by RETScreen. The specific speed of the turbine was computed using number of nozzles = 1 (for simplicity and ease of manufacture). This was used to compute the turbine runner diameter, D_T in metres. Five (5) different values of D_T were obtained corresponding to the five penstock sizes selected which were then scaled upwards. The scaled values of D_T used for this work were 0.25, 0.30, 0.35, 0.40 and 0.45 m. The hub diameter and hence, blade height or cup length was found using an expression given by [117] as well as the blade height. The number of blades was selected from a chart of parameters for sizing turbines by [124] to be 6.

The hub and cups were cast from aluminium after carrying out the necessary preliminary tests and preparations to the sizes obtained. The cups were diametrically welded to the hub using gas welding. Two circular flanges made of 2 mm steel sheet to facilitate the coupling of a steel

shaft of 20 mm diameter to the hub is welded to the shaft after passing the shaft through a hole in it. The flange has provisions for three (3) M14 bolts and nuts evenly located along a convenient circumferential plane so that the hub with the cups are clamped perpendicular to the shaft. An average ratio of flange diameter (D_f) to hub diameter (D_h) of 0.75 was used for the 5 turbines. Fig. 1 shows the assembled turbine runner. The assembled turbine was mounted in a casing made of 4 mm sheet steel and externally reinforced having an annulus or flow area (A) which satisfies the minimum condition for a clearance of about 0.03 m. Figure 2 shows an assembled turbine. Appropriate bearings and seals were selected for mounting the turbine to facilitate free rotation and to prevent leakages. The casing cover was secured in position using M13 and M14 bolts and nuts. The support of the turbine was made of a combination of 5 mm u-channel and 4 mm angle iron with provisions for four M20 foundation bolts. The exit duct was of rectangular cross-section and tapered to a 76.2 mm diameter internally threaded cylindrical adaptor. The duct was conveniently slanted in order to enhance discharge of water from the turbine. Fig. 3 shows an exploded view of the turbine.

The nozzles were fabricated using 1 mm thick steel sheet. The development of each was cut out of the sheet metal which was then appropriately folded and welded using gas welding because of the light gauge of the metal. The nozzles had a mean height of 50 cm. Figure 4 shows all the nozzles used for the study, each set of 5 including nozzles of area ratios 1.0 to 0.2.

Fig. 5 shows the complete set up for the study while Fig. 6 shows an enlarged view of the components on the ground. It has two reservoirs, one mounted overhead and the other underground. The arrangement was such that the overhead reservoir delivers water to the turbine through the penstock. Five nozzles of similar length of about 50 cm were fabricated for each penstock diameter with area ratios of 1.0, 0.8, 0.6, 0.4 and 0.2 to facilitate flow acceleration at the exit of the penstock. Water from the nozzles impinges on the turbine blades when the outlet valve of the overhead reservoir is opened. The whole turbine assembly is mounted horizontally with the water outlet port conveniently inclined such that flow from the turbine casing is enhanced. The turbine discharges water to the ground reservoir. The

water is then re-circulated to the overhead reservoir by a 1.11 kW DAB Model electric pump. The pump has a rated flow rate of 3.0 – 10.8 m³/h (0.833 – 3.0 x 10⁻³ m³/s) with maximum and minimum heads of 29 m and 17 m respectively and 220 – 240V, 7.1A.

For this study, the head, $H \approx 6.95$ m. The experimental system discharge was then determined for each penstock size by timing the discharge of water from the overhead reservoir. The rotational speed of the shaft of the turbine (N) was measured using the DT-2268 and DT-2858 Contact Type Digital Tachometer for each penstock diameter and nozzle configuration. The tachometers had a 5-digit, 10 mm LCD display with measurement range of 2.5 – 99,999 Rpm. The resolution is 1 Rpm over 1000 Rpm with accuracy of $\pm 0.05\% + 1$ Rpm and photo detecting distance of up to 300 mm. The tachometers have memory capability of showing the last value, maximum value and minimum value, and a typical sampling time of 1 second.

The measurements were carried out without coupling the alternator to the turbine (no-load tests). The rotor of the tachometer was pressed lightly into a blind hole on the rotating shaft in order to measure the rotational speed. This was repeated several times depending on the duration for a particular measurement which was limited by the water level in the reservoir on the ground. During this period, the maximum and minimum rotational speed were observed and recorded. An average duration of about 4.24 minutes/measurement was used throughout with the minimum and maximum values being 1.73 and 6.75 minutes. The whole procedure was carried out for each of the 5 turbines. The values of N were corrected for losses imposed by the provision for discharging water into the reservoir on the ground by applying a factor of H_d/H , where H_d = the height of the delivery port above the plain of the turbine shaft and H = head.

For the 4 smaller penstock diameters, the values of N were also corrected because the delivery pipe to the ground reservoir was not reduced to match their smaller diameters. A factor of D_p/D_d , where D_d = diameter of the delivery pipe and D_p = diameter of penstock. The water levels in the two reservoirs were monitored simultaneously using a dip stick along with a measuring tape and used to obtain the volume of water discharged. The volumetric flow rates were then computed. The fluid power (P_f) available for each operation was computed using the relationship given by [111] and [76]. The shaft power, P_s , and

efficiency of the system were computed from first principles using equations given by the same author.

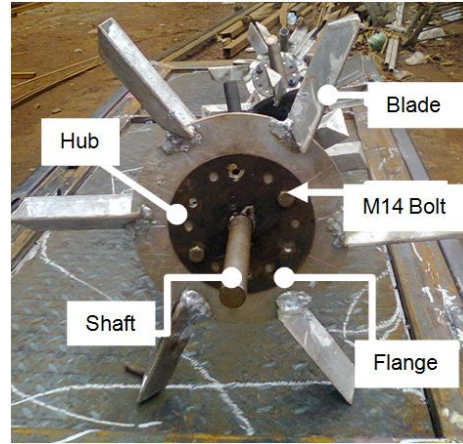


Fig. 1. A turbine runner assembly for the system

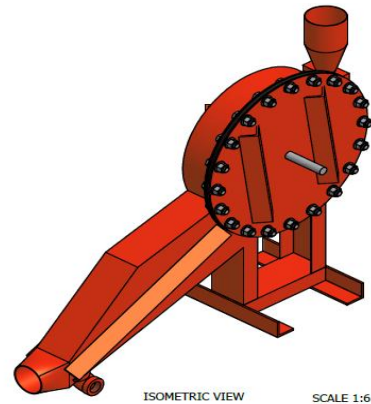


Fig. 2. An assembled turbine

Based on results of dimensionless analysis, the dimensionless groups flow, head and power coefficients as well as specific speed were computed using equations 4 to 7 respectively. The head and power coefficients were plotted against the flow coefficients to formulate a functional relationship between them. They can be computed using the expressions below [108-110].

$$\text{Flow coefficient, } K_Q = Q/ND^3 \quad (4)$$

$$\text{Head coefficient, } K_H = gH/N^2D^2 \quad (5)$$

$$\text{Power coefficient, } K_P = P/\rho N^3D^5 \quad (6)$$

$$\text{Specific speed, } K_S = K_P^{1/2}/K_H^{5/4} \quad (7)$$

The net head flow rate characteristic was established for the system.

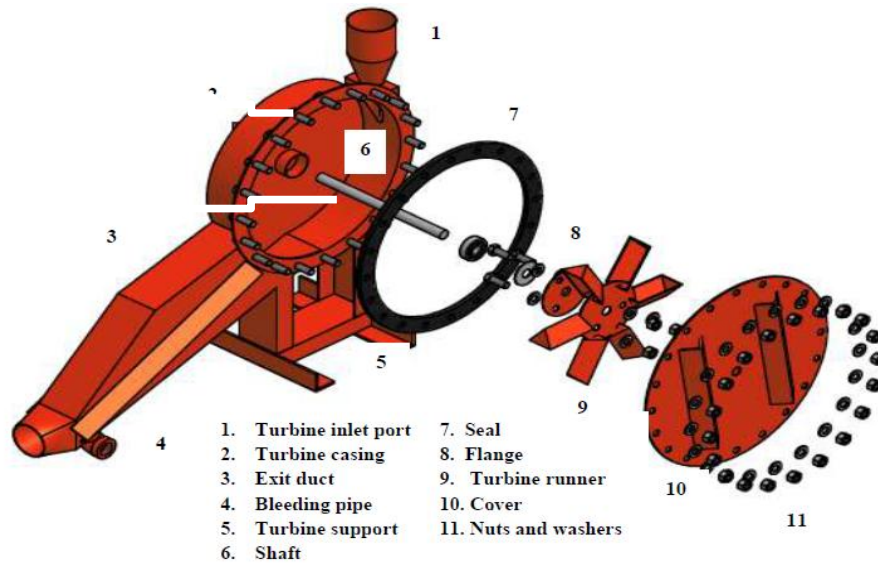


Fig. 3. Exploded view of the turbine



(a) 0.0762 m

(b) 0.0635 m

(c) 0.0508 m

(d) 0.0445 m

(e) 0.0381 m

Fig. 4. The nozzles used for the indicated penstock diameters

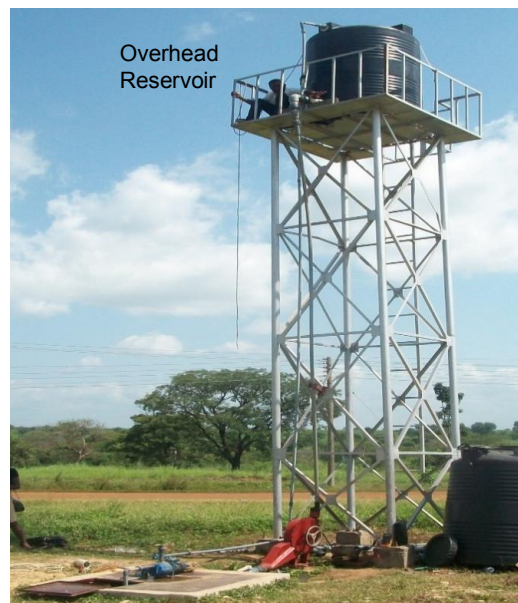


Fig. 5. The Pico-Hydropower System

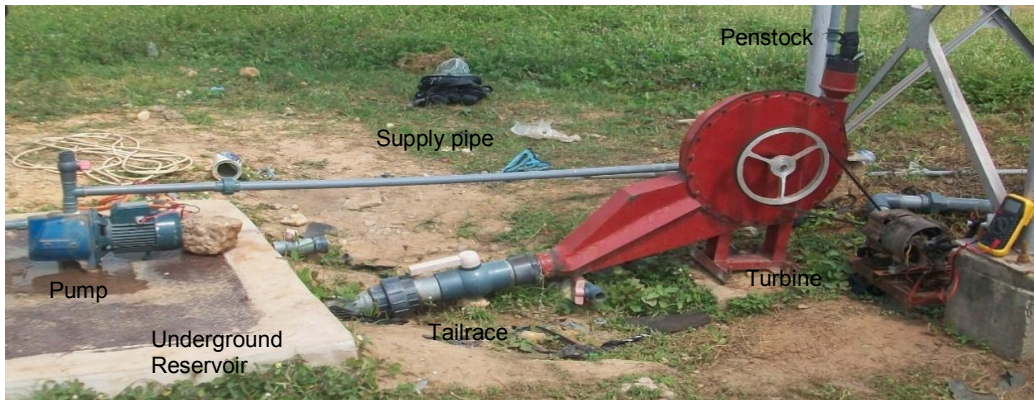


Fig. 6. Enlarged view of the 1.11 KW Pump, Turbine and penstock

3. RESULTS AND DISCUSSION

For this study, the mean values of the flow rate and the net head for the no-load tests as presented in Table 1 were plotted in Fig. 7. The characteristic curve was parabolic in nature with R^2 value of 0.9697. The trend is as is obtainable in previous studies [109,110,126,132-142]. It has the following expression given in equation 8:

$$H_{n,avg} = -27132Q_{avg}^2 + 740.6Q_{avg} + 1.5363 \quad (8)$$

where $H_{n,avg}$ = mean system net head (m) and Q_{avg} = mean system flow rate (m^3/s). This expression can be very useful in obtaining an initial design for scaling up flow rate for further developments of the system for given values of $H_{n,avg}$ [143-149].

Based on results of dimensionless analysis of hydraulic turbine parameters, four coefficients were computed to summarize and generalize their performance. The coefficients were head, flow and power coefficients as well as the specific speed. They were computed using

equations 4 to 7. These formulations will be very useful especially with regards to future plans to scale up the system in order to generate higher power [150,151]. They will be invaluable for initial design data and are key to the expectation of achieving this system in its eventual application form. The computed values of the coefficients are shown in Table 1.

Fig. 8 relates the mean head coefficient (K_H) to the mean flow coefficient (K_Q). For this work, the characteristic curve is parabolic with R^2 value of 0.9939 and the expression is given in equation 9.

$$K_H = 1765.2K_Q^2 - 1.6098K_Q + 0.0027 \quad (9)$$

Fig. 9 shows the corresponding curve for the relationship between the mean power coefficient and the flow coefficient which also has a parabolic trend with R^2 value of 0.9982. The expression obtained is shown in equation 10.

$$K_P = 3.4689K_Q^2 - 0.0019K_Q + 1 \times 10^{-6} \quad (10)$$

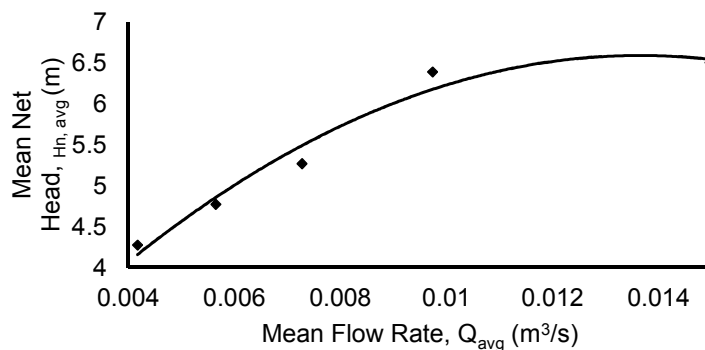


Fig. 7. Mean net head and flow rate characteristic for the system

The coefficients constitute a set of performance characteristics representing the whole family of five turbines that were fabricated for this work. They are identical for all of them as long as parameters such as Mach number, Reynolds's number and relative surface roughness of the pipe walls are the same, or can be assumed constant. This assumption holds for this work. Applying similarity laws and based on the assumptions above, these coefficients can be used to predict the performance of another similar turbine running with smaller or larger runner diameter running at a given speed [108-110,115].

According to [108] and [109], the specific speed (K_S) can be obtained from equation 7 by manipulating K_Q , K_H and K_P . The mean values of the computed K_S from experimental data for each of the family of five turbines is shown in Table 1. They all lie within the range $1.7 < K_S < 3.0$. Though these values are quite small compared to the range of 10 to 35 reported by [111] and [117] for one-jet Pelton turbines, they are close to each other, strengthening an earlier suggestion in the process of the larger scope of the study that the difference between the runner diameters was not large enough to significantly impact upon their performances.

Table 1. Computed dimensionless coefficients for the turbines for penstock of diameter 0.0762 m

| Turbine Runner Dia., D_T (m) | Nozzle area ratio, A_2/A_1 | Head Coeff., $K_H \times 10^{-3}$ | Flow Coeff., $K_Q \times 10^{-4}$ | Power Coeff., $K_P \times 10^{-6}$ | Specific speed K_S |
|--------------------------------|------------------------------|-----------------------------------|-----------------------------------|------------------------------------|----------------------|
| 0.45 | 1.0 | 4.196 | 8.182 | 3.433 | 1.735 |
| | 0.8 | 3.832 | 6.980 | 2.675 | 1.715 |
| | 0.6 | 3.104 | 5.933 | 1.841 | 1.852 |
| | 0.4 | 2.887 | 4.511 | 1.302 | 1.705 |
| | 0.2 | 2.373 | 2.871 | 0.681 | 1.576 |
| | | | | | 1.717 |
| 0.40 | 1.0 | 3.278 | 9.073 | 2.974 | 2.199 |
| | 0.8 | 2.527 | 7.014 | 1.772 | 2.350 |
| | 0.6 | 2.405 | 6.296 | 1.514 | 2.310 |
| | 0.4 | 2.145 | 4.319 | 0.927 | 2.086 |
| | 0.2 | 2.141 | 3.207 | 0.686 | 1.798 |
| | | | | | 2.149 |
| 0.35 | 1.0 | 4.211 | 12.586 | 5.300 | 2.146 |
| | 0.8 | 3.714 | 10.841 | 4.027 | 2.189 |
| | 0.6 | 3.273 | 9.251 | 3.028 | 2.223 |
| | 0.4 | 2.666 | 6.684 | 1.782 | 2.204 |
| | 0.2 | 2.097 | 4.423 | 0.928 | 2.147 |
| | | | | | 2.182 |
| 0.30 | 1.0 | 3.581 | 15.884 | 5.688 | 2.723 |
| | 0.8 | 2.475 | 12.348 | 3.056 | 3.166 |
| | 0.6 | 2.144 | 11.305 | 2.424 | 3.375 |
| | 0.4 | 2.118 | 8.926 | 1.895 | 3.030 |
| | 0.2 | 2.066 | 6.541 | 1.351 | 2.639 |
| | | | | | 2.987 |
| 0.25 | 1.0 | 3.973 | 23.152 | 9.198 | 3.041 |
| | 0.8 | 3.619 | 20.402 | 7.384 | 3.061 |
| | 0.6 | 3.121 | 17.412 | 5.435 | 3.160 |
| | 0.4 | 3.099 | 14.209 | 4.347 | 2.851 |
| | 0.2 | 3.013 | 9.441 | 2.842 | 2.388 |
| | | | | | 2.900 |

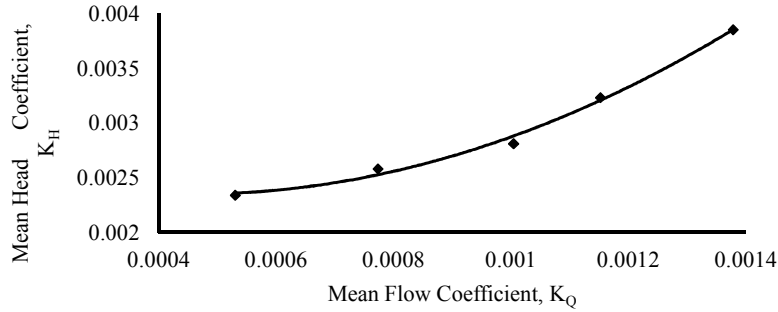


Fig. 8. Variation of mean head coefficient with mean flow coefficient for the turbines

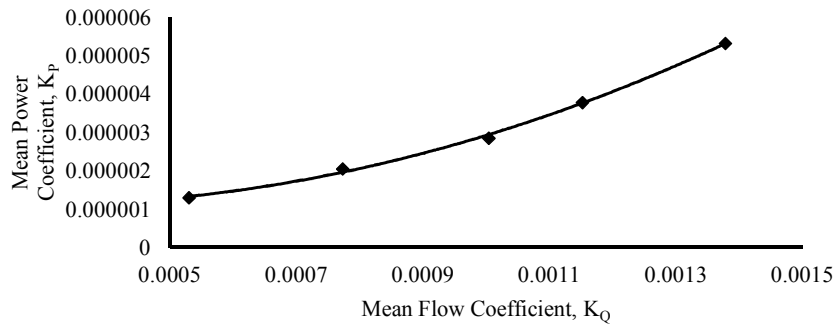


Fig. 9. Variation of mean power coefficient with mean flow coefficient for the turbines

4. CONCLUSION

So far, the findings in this work on the simplified pico-hydro system show that potential exists for it to contribute positively towards ameliorating the energy crunch in Nigeria and other developing countries as a unit that will operate without dependence on unpredictable climate conditions, without adverse effects on the environment and which concedes control to the end user. Further development is however necessary to fully realize this potential. Its parameters need to be properly manipulated to achieve a self-running status before it can become commercially useful.

The following conclusions are hereby drawn from this experimental study:

- (1) Dimensionless groups to summarise the performance of the five turbines used for the study have been formulated which will be invaluable when the system will be modified for better power generation; and
- (2) The net head and flow rate characteristic for the system has been established which will be useful for obtaining base data for future work;

The recommendations for this work are issues for the next phase(s). Based on the current findings and the original aspirations of this study, further funding will be sought so that the following aspects could be investigated:

- (1) The delivery pipe from the pump will be modified to cause the ratio of delivery to discharge from the reservoir to be more favourable for system performance;
- (2) The system will be tested with the overhead reservoir located above 7.0 m to take advantage of greater head;
- (3) The effect of multiple overhead reservoirs (or larger capacity ones) will be investigated;
- (4) The introduction of solar power for the recycling system in order to explore the hybridization option; and
- (5) An economic comparative analysis of this system with a stand-alone solar power system and a fossil fuel powered system will also be undertaken.

COMPETING INTERESTS

Authors have declared that no competing interests exist.

REFERENCES

1. Arto I, Capellán-Pérez I, Lago R, Bueno G, Bermejo R. The energy requirements of a developed world. *Energy for Sustainable Development* 2016;33:1-13.
2. Bergasse E, Paczynski W, Dabrowski M, Dewulf L. The relationship between energy and socio-economic development in the southern and eastern Mediterranean. MEDPRO Technical Report No. 27; 2013. Available:[https://www.ceps.eu/system/files/MEDPRO%20TR27CASE%20Bergasse%20Energy%20and%20Socio-economic%20Development updated15Feb2013.pdf](https://www.ceps.eu/system/files/MEDPRO%20TR27CASE%20Bergasse%20Energy%20and%20Socio-economic%20Development%20updated15Feb2013.pdf)
3. British Petroleum. BP Energy Outlook 2017 Edition. 2017;9-22,74-77,90-94. Available:www.bp.com/energy_outlook#BPstats
4. ECA. Correlation and causation between energy development and economic growth. Economic Consulting Associates; 2014. Available:<file:///C:/Users/ncc/Downloads/EoDHD116Jan2014EnergyEconomicGrowth.pdf>
5. Pirlogea C, Cicea C. Econometric perspective of the energy consumption and economic growth relation in European Union. *Renewable and Sustainable Energy Reviews*. 2012;16:5718–5726.
6. Saatci M, Dumrul Y. The relationship between energy consumption and economic growth: Evidence from a structural break analysis for Turkey. *International Journal of Energy Economics and Policy*. 2013;3(1):20-29.
7. Shezi L. Nearly 60% of Africans have no access to reliable electricity; 2015. Available:<http://www.htxt.co.za/2015/05/08/nearly-60-of-africans-have-no-access-to-reliable-electricity/>
8. UNDESA. Electricity and education: The benefits, barriers and actions for achieving the electrification of primary and secondary schools. United Nations Department of Economic and Social Affairs; 2014. Available:https://sustainabledevelopment.un.org/content/documents/1608_Electricity%20and%20Education.pdf
9. Edomah N. On the path to sustainability: Key issues on Nigeria's sustainable energy development, *Energy Reports*. 2016;2:28-34.
10. Sambo AS. The role of energy in achieving millennium development goals (MDGs), keynote address at the national engineering technology conference (NETec 2008). Ahmadu Bello University, Zaria, 1st April; 2008.
11. Sambo AS. Matching electricity supply with demand in Nigeria. *International Association for Energy Economics*, 4th Quarter. 2008;32-36.
12. Shittu J. Towards achieving sustainable development for all: Prioritizing targets for implementation: Which way forward for Nigeria? Center for Public Policy Alternatives; 2015. Available:www.cpparesearch.org/wp-content/uploads/2015/05/Country-profile-on-SDGs-Nigeria-Final-Version.pdf
13. MDGs. Nigeria – Millennium Development Goals End point Report; 2015. Available:www.mdgs.gov.ng
14. Bala EJ. Renewable energy and energy efficiency development in Nigeria, Keynote Paper at the 2-day Workshop on Renewable Energy and Energy Efficiency, 10th–11th June, 2013, Nnamdi Azikiwe University, Awka; 2013.
15. Akuru UB, Okoro OI. A prediction on Nigeria's oil depletion based on hubbert's model and the need for renewable energy. *ISRN Renewable Energy*; 2011. Article ID 285649
16. Olusegun HD, Adekunle AS, Ohijeagbon IO, Oladosu OA, Ajimotokan HA. Retrofitting a hydropower turbine for the generation of clean electrical power. *USEP: Journal of Research Information in Civil Engineering*. 2010;7(2):61-69.
17. Bala EJ. Achieving renewable energy potential in Africa, Joint WEC, AUC and APUA Workshop, Addis Ababa, Ethiopia; 2013.
18. Sambo AS. Strategic development in renewable energy in Nigeria. *International Association of Energy Economics*; 2009; 4:15-19.
19. Aslani A. Private sector investment in renewable energy utilization: Strategic analysis of stakeholder perspectives in developing countries. *International Journal of Sustainable Energy*. 2013;1-13.
20. Ranjeva M, Kulkarni AK. Design optimization of a hybrid, small, decentralized power plant for remote/rural areas, *Energy Procedia*, 20. Technoport RERC Research. 2012;258–270.
21. Razak JA, Sopian K, Ali Y, Alghoul MA, Zaharim A, Ahmad I. Optimization of PV-wind-hydro-diesel hybrid system by

- minimizing excess capacity. *European J. of Scientific Research*. 2009;25(4):663-671.
22. Cancino-Solorzano Y, Villicana-Ortiz E, Gutierrez-Trashorras AJ, Xiberta-Bernat J. Electricity sector in Mexico: Current status. Contribution of renewable energy sources. *Renewable and Sustainable Energy Reviews*. 2010;14:454–461.
 23. Choi Y, Lee C, Song J. Review of renewable energy technologies utilized in the oil and gas industry. *International Journal of Renewable Energy Research*. 2017;7(2).
 24. Goodbody C, Walsh E, McDonnell KP, Owende P. Regional integration of renewable energy systems in Ireland: The role of hybrid energy systems for small communities. *Electrical Power and Energy Systems*. 2013;44:713–720.
 25. Hossain E, Perez R, Bayindir R. Implementation of hybrid energy storage systems to compensate microgrid instability in the presence of constant power loads. *International Journal of Renewable Energy Research*. 2017;7(2).
 26. Kumar A, Biswas A. Techno-economic optimization of stand-alone pv/pbs/battery systems for very low load situation. *International Journal of Renewable Energy Research*. 2017;7(2):848-856.
 27. Lipu MSH, Hafiz MG, Ullah MS, Hossain A, Munia FY. Design optimization and sensitivity analysis of hybrid renewable energy systems: A case of Saint Martin Island in Bangladesh. *International Journal of Renewable Energy Research*. 2017; 7(2).
 28. Margeta J, Glasnovic Z. Feasibility of the green energy production by hybrid solar + hydro power system in Europe and similar climate areas. *Renewable and Sustainable Energy Reviews*. 2010;14:1580–1590.
 29. McHenry MP. Small-scale ($\leq 6kW_e$) stand-alone and grid-connected photovoltaic, wind, hydroelectric, biodiesel, and wood gasification system's simulated technical, economic, and mitigation analyses for rural regions in Western Australia. *Renewable Energy*. 2012;38:195–205.
 30. Ribal A, Amir AK, Toaha S, Kusuma J, Khaeruddin K. Tidal current energy resource assessment around Buton Island, southeast Sulawesi, Indonesia. *International Journal of Renewable Energy Research*. 2017;7(2).
 31. Samy MM. Techno-economic analysis of hybrid renewable energy systems for electrification of rustic area in Egypt. *Innovative Systems Design and Engineering*. 2017;8(1).
 32. Melikoglu M. Vision 2023: Feasibility analysis of Turkey's renewable energy projection. *Renewable Energy*. 2013;50: 570–575.
 33. Mondal MAH, Kamp LM, Pachova NI. Drivers, barriers, and strategies for implementation of renewable energy technologies in rural areas in Bangladesh - an innovation system analysis. *Energy Policy*. 2010;38:4626-4634.
 34. Okonkwo EC, Okwose CF, Abbasoglu S. Techno-economic analysis of the potential utilization of a hybrid Pv-wind turbine system for commercial buildings in Jordan. *International Journal of Renewable Energy Research*. 2017;7(2):908-914.
 35. Paun D, Paun CA. The impact of renewable energy on the price of energy in Romania. *International Journal of Renewable Energy Research*. 2017;7(2).
 36. Toklu E. Overview of potential and utilization of renewable energy sources in Turkey. *Renewable Energy*. 2013;50:456–463.
 37. Tukenmez M, Demireli E. Renewable energy policy in Turkey with the new legal regulations. *Renewable Energy*. 2012; 39:1–9.
 38. UNFCCC. Facilitating technology deployment in distributed renewable electricity generation. United Nations Framework Convention on Climate Change; 2015. Available:<http://unfccc.int/ttclear/misc/StaticFiles/gnwoerkstatic/TECdocuments/6d62b12d1a87483da716d80e77d5349b/b4539aaf699b459e9998606868dd49bd.pdf>
 39. WHO. Health in 2015: From Millennium Development Goals (MDGs) to Sustainable Development Goals (SDGs). 2015;3-11. Available:www.who.int
 40. Yuksel I. Renewable energy status of electricity generation for future prospect. *Renewable Energy*. 2013;50:1037-1043.
 41. Nepal R. Roles and potentials of renewable energy in less-developed economies: The case of Nepal. *Renewable and Sustainable Energy Reviews*. 2012;16(4):2200–2206.
 42. Nfah EM, Ngundam JM. Identification of stakeholders for sustainable renewable energy applications in Cameroon.

- Renewable and Sustainable Energy Reviews. 2012;16:4661–4666.
43. Ong HC, Mahlia TMI, Masjuki HH. A review on energy scenario and sustainable energy in Malaysia. *Renewable and Sustainable Energy Reviews*. 2011;15: 639–647.
 44. Sambo AS. Enhancing renewable energy access for sustainable socio-economic development in Sub-Saharan Africa. *J. of Renewable and Alternative Energy Technologies*. 2015;1(1):1-5.
 45. Abbasi T, Abbasi SA. Small hydro and the environmental implications of its extensive utilization. *Renewable and Sustainable Energy Reviews*. 2011;15:2134-2143.
 46. Bakken TH, Sundt H, Ruud A, Harby A. Development of small versus large hydropower in Norway comparison of environmental impacts. *Technoport RERC Research, Energy Procedia*. 2012;20:185-199.
 47. Chen S, Chen B, Su M. An estimation of ecological risk after dam construction in Lrgr, China: Changes on heavy metal pollution and plant distribution. *Procedia Environmental Sciences*. 2010. International workshop from the International Congress on Environmental Modelling and Software. 2011;5:153–159.
 48. Chen S, Fath B, Chen B, Su M. Evaluation of the changed properties of aquatic animals after dam construction using ecological network analysis. *Procedia Environmental Sciences*. International Workshop from the International Congress on Environmental Modelling and Software. 2011;5:114–119.
 49. da Silva JJLS, Marques M, Damásio JM. Impacts on tocantins river aquatic ecosystems resulting from the development of the hydropower potential. *Ambientee Água, Interdisciplinary Journal of Applied Science*. 2010;5(1):189-203.
 50. Hussey K, Pittock J. The energy–water nexus: Managing the links between energy and water for a sustainable future. *Ecology and Society*. 2012;17(1):31–39.
 51. Khadka RB, Mathema A, Shrestha US. Determination of the significance of environmental impacts of development projects: A case study of environmental impact assessment of indrawati-3 hydropower project in Nepal. *Journal of Environmental Protection*. 2011;2:1021–1031.
 52. Jia-kun LI. Research on prospect and problem for hydropower development of China. *Inter. Conference on Modern Hydraulic Engineering, Procedia Engineering*. 2012;28:677-682.
 53. Olukanmi DO, Salami AW. Assessment of impact of hydropower dams reservoir outflow on the downstream river flood regime – Nigeria’s experience. *Hydropower – Practice and Application*, Dr. Hossein Sammad-Boroujeni (Ed.); 2012. Available:http://www.intechopen.com/book_s/hydropower-practice-and-application/assessment-of-impact-of-hydropower-dams-reservoir-overflow-on-the-downstream-river-flood-regime-niger
 54. Sousa Junior WC, Reid J. Uncertainties in Amazon hydropower development: Risk scenarios and environmental issues around the Belo Monte dam. *Water Alternatives*. 2010;3(2):249–268.
 55. Usman A, Ifabiyi IP. Socio-economic analysis of the operational impacts of Shiroro hydropower generation in the lowland areas of middle River Niger. *Inter. Journal of Academic Research in Business and Social Sciences*. 2012;2(4):57–76.
 56. Amor MB, Pineau P, Gaudreault C, Samson R. Electricity trade and GHG emissions: Assessment of quebec’s hydropower in the North-Eastern American market (2006 – 2008). *Energy Policy*. 2011;39:1711–1721.
 57. Baumann P, Stevanella G. Fish passage principles to be considered for medium and large dams: The case study of a fish passage concept for a hydroelectric power project on the Mekong mainstream in Laos. *Ecological Engineering*. 2012;48:79–85.
 58. Chanudet V, Descloux S, Harby A, Sundt H, Hansen BH, Brakstad O, Serça D, Guerin F. Gross CO₂ and CH₄ emissions from the Nam Ngum and Nam Leuk Sub-tropical reservoirs in Lao PDR. *Science of the Total Environment*. 2012;409:5382–5391.
 59. Demarty M, Bastien, J. GHG emissions from hydroelectric reservoirs in tropical and equatorial regions: Review of 20 years of CH₄ emission measurements. *Energy Policy*. 2011;39(7):4197–4206.
 60. Deng Z, Carlson TJ, Dauble DD, Ploskey GR. Fish passage assessment of an advanced hydropower turbine and conventional turbine using blade-strike modelling. *Energies*. 2011;4:57–67.

61. Deng ZD, Martinez JJ, Colotelo AH, Abel TK, LeBarge AP, Brown RS, Pflugrath BD, Mueller RP, Carlson TJ, Seaburg AG, Johnson RL, Ahmann ML. Development of external and neutrally buoyant acoustic transmitters for juvenile salmon turbine passage evaluation. *Fisheries Research*. 2012;113:94-105.
62. Fjeldstad HP, Uglem I, Diserud OH, Fiske P, Forseth T, Kvingedal E, Hvidsten NA, Økland F, Järnegren J. A concept for improving Atlantic salmon *Salmo Salar* Smolt migration past hydro power intakes. *Journal of Fish Biology*. 2012;81:642-663.
63. Miller VB, Landis AE, Schaefer LA. A benchmark for life cycle air emissions and life cycle impact assessment of hydrokinetic energy extraction using life cycle assessment. *Renewable Energy*. 2011;36:1040-1046.
64. Travade F, Larinier M, Subra S, Gomes P, De-Oliveira E. Behaviour and passage of European silver eels (*Anguilla Anguilla*) at a small hydropower plant during their downstream migration. *Knowledge and Mgt of Aquatic Ecosystems*. 2010;398:1-19.
65. Uzoewulu NL. Management and maintenance of reservoir water storage in a hydropower station. *Proc. of 19th Engineering Assembly of Council for the Regulation of Engineering in Nigeria (COREN)*. 2010;126-130.
66. Yewhalaw D, Legesse W, Van Bortel W, Gebre-Selassie S, Kloos H, Duchateau L, Speybroeck N. Malaria and water resource development: The case of Gilgel-Gibe hydroelectric dam in Ethiopia. *Malaria Journal*. 2009;8:21-30.
67. Barros RM; Filho GLT. small hydropower and carbon credits revenue for an shp project in national isolated and interconnected systems in Brazil. *Renewable Energy*. 2012;48:2-34.
68. Capik M, Yilmaz AO, Cavusoglu I. Hydropower for sustainable energy development in Turkey: The small hydropower case of the eastern black sea region. *Renewable and Sustainable Energy Reviews*. 2012;16:6160-6172.
69. Kaunda CS, Kimambo CZ, Nielsen TK. Potential of small-scale hydropower for electricity generation in Sub-Saharan Africa. *ISRN Renewable Energy*; 2012. Article ID 132606
70. Nautiyal H, Singal SK, Varun, Sharma A. Small hydropower for sustainable energy development in India. *Renewable and Sustainable Energy Reviews*. 2011;15: 2021-2027.
71. Ohunakin OS, Ojolo SJ, Ajayi OO. Small hydropower (SHP) development in Nigeria. *Renewable and Sustainable Energy Reviews*. 2011;15:2006-2013.
72. Stark BH, Andò E, Hartley G. Modelling and performance of a small siphonic hydropower system. *Renewable Energy*. 2011;36:2451-2464.
73. Taelle BM, Mokhutšoane L, Hapazari I. An overview of small hydropower development in Lesotho: Challenges and prospects. *Renewable Energy*. 2012;44: 448-452.
74. Hamududu B, Killingtveit A. Assessing Climate Change Impacts on Global Hydropower. *Energies*. 2012;5:305-322.
75. ESHA. Current status of small hydropower development in the EU-27. *European Small Hydropower Association*; 2010. Available:http://www.streammap.esha.be/6_0.html
76. ESHA. Small hydro for developing countries, support from thematic network on hydropower project. *European Small Hydropower Association, European Commission*; 2006.
77. ESHA. Guide on how to develop a small hydropower plant. *European Small Hydropower Association*; 2004. Available:<http://www.esha.be/>
78. Ion CP Marinescu C. Autonomous micro hydro power plant with induction generator. *Renewable Energy*. 2011;36:2259-2267.
79. Kosa P, Kulworawanichpong T, Srivoramas R, Chinkulkijniwat A, Horpibulsuk S, Teaumroong N. The potentials of micro-hydropower projects in Nakhon Ratchasima province, Thailand. *Renewable Energy*. 2011;36: 133-1137.
80. Pascale A, Urmee T, Moore A. Life cycle assessment of a community hydroelectric system in rural Thailand. *Renewable Energy*. 2011;36(11):2799-2808.
81. Edeoja AO, Ibrahim JS, Kucha EI. Suitability of Pico-hydropower technology for addressing the Nigerian energy crisis – A review. *Inter. Journal of Engineering Inventions*. 2015;4(9):17-40.
82. Al Amin R, Talukder AH. Introducing Pico hydro from daily used water and rain water. *Int. Journal of Engineering Research and Applications*. 2014;4(1-2): 382-385.

83. Fadhel MI. Research and development aspects of Pico-Hydropower. *Renewable and Sustainable Energy Reviews*. 2012; 16:5861–5878.
84. Haidar MA, Senan FM, Noman A, Taha R. Utilization of Pico hydro generation in domestic and commercial loads. *Renewable and Sustainable Energy Reviews*. 2012;16:518-524.
85. Lahimer V, Alghoul M, Sopian KB, Fadhel MI. Research and development aspects of pico-hydro power. *Renewable and Sustainable Energy Reviews*. 2012;16(8): 5861-5878.
86. Martin S, Sharma AK. Analysis on rainwater harvesting and its utilization for Pico hydro power generation. *Inter. Journal of Advanced Research in Computer Engineering & Technology*. 2014;3(6).
87. Nimje AA, Dhanjode G. Pico-hydro-plant for small scale power generation in remote villages. *IOSR Journal of Environmental Science, Toxicology and Food Technology*. 2015;9(1)Ver.III:59-67.
88. Othman MM, Razak AJ, Basar M, Muhammad N, Wan Mohammad W, Sopian K, A Review of the Pico-hydro turbine: Studies on the propeller hydro type. *Inter. Review of Mech. Engineering*. 2015;9(6):527-535.
89. Ridzuan MJM, Hafis SM, Azduwin K, Firdaus KM, Zarina Z. Development of Pico-hydro turbine for domestic use. *Applied Mechanics and Materials*. 2015; 695:408-412.
90. Smith N, Bush SR. A light left in the dark: The practice and politics of Pico Hydro power in the load PDR. *Energy Policy*. 2010;38(1):116-127.
91. Smith N, Williams A. Assessment of Pico hydro as an option for off grid electrification in Kenya. *Micro Hydro Centre Nottingham Trent University*. 2003;1357-1369.
92. Sopian K, Ab. Razak J. Pico hydro: Clean power from small streams. *Proc. of the 3rd WSEAS. International Conference on Renewable Energy Sources*. 2009;414-419.
93. Susanto J, Stamp S. Local installation methods for low head Pico-hydropower in the Lao PDR. *Renewable Energy*. 2012; 44:439-447.
94. Williams A. Pico hydro for cost effective lighting. *Boiling Point Magazine*. 2007;14-16.
95. Wohlgemuth M. Assessment of Pico-hydro power potential in rural ethiopia, bachelor of science thesis. Department for Hydrology and River Basin Management. Technische Universität München; 2014.
96. Williams AA, Simpson R. Pico Hydro – reducing technical risk for rural electrification. *Renewable Energy*. 2009; 34:1986–1991.
97. Xuhe W, Baoshan Z, Lei T, Jie Z, Shuliang C. Development of a pump-turbine runner based on multi-objective optimization, 27th IAHR Symposium on Hydraulic Machinery and Systems (IAHR 2014). *IOP Conf. Series: Earth and Environmental Science*. 2014;22.
98. Maher P. Kenya case study 1 at Kathamba and case study 2 at Thima; 2002. Available:<http://www.eee.nottingham.ac.uk/picohydro/documents.html#kenya>
99. Edeoja AO, Ibrahim JS, Kucha EI. Conceptual design of a simplified decentralized Pico hydropower with provision for recycling water. *Journal of Multidisciplinary Engineering Science and Technology*. 2015;2(2).
100. Edeoja AO, Awuniji L. Experimental investigation of the influence of penstock configuration and angle of twist of flat blades on the performance of a simplified Pico-hydro system. *European Journal of Engineering Research and Science*. 2017; 2(7):14-22.
101. Edeoja AO, Ajeibi LE, Effiong AD. Influence of penstock outlet diameter and turbine hub to blade ratio on the performance of a simplified Pico hydropower system. *Int. J. of Precious Engineering Research and Applications*. 2017;2(5):31-46.
102. Edeoja AO, Ekoja M, Tuleun LT. Effect of penstock area reduction and number of turbine v-blades on the performance of a simple Pico-hydropower system. *European Journal of Advances in Engineering and Technology*. 2017;4(11):797-806.
103. Edeoja AO, Edeoja JA, Ogboji ME. Effect of the included angle of v-shaped blade on the performance of a simplified Pico-hydro system. *Int. J. of Scientific & Engineering Research*. 2017;8(8):1208–1213.
104. Edeoja AO, Ibrahim JS, Kucha EI. Investigation of the effect of penstock configuration on the performance of a simplified Pico-hydro system. *British Journal of Applied Science & Technology*. 2016;14(5):1-11.
105. Edeoja AO, Ibrahim JS, Tuleun LT. Effect of blade cross-section on the

- performance of a simplified pico-hydro system. American Journal of Engineering Research. 2016;5(12):1–9.
106. Edeoja AO, Edeoja JA, Ogboji ME. Effect of number of turbine runner V-blades on the performance of a simple Pico-hydro system. Accepted for Publication in International Journal of Engineering and Technology. Reference number 316145147726833; 2016.
 107. Ipilakyaa DT, Edeoja AO, Kulugh A. Influence of penstock outlet diameter and flat blade lateral twist angle on the performance of a simplified pico hydro-power system. International Journal of Trend in Scientific Research and Development. 2017;1(5):394-406.
 108. Uppal SL, Rao S. Electrical power systems: Generation, transmission, distribution and utilization of electrical energy. 15th Edition, Khanna Publishers, New Delhi. 2012;175–180.
 109. Ingram G. Basic concepts in Turbomachinery, Grant Ingram and Ventus Publishing ApS. 2009;17:88-91. Available:www.bookboon.com
 110. Douglas JF, Gasiorek JM, Swaffield JA. Fluid mechanics, ELBS edition of the 3rd edition, ISBN 0 582 30555 1. Produced by Longman Singapore Publishers (Pte) Ltd. 1997;315,316,666–678.
 111. Muchira MJ. Performance of a modified vehicle drive system in generating hydropower. A Thesis submitted for MSc. Renewable Energy Technology, Kenyatta University, Kenya. 2011;44.
 112. Wang L. A micro hydro power generation system for sustainable micro grid development in rural electrification in Africa. In: IEE Power Energy Society Meeting, Calgary, Canada. 2009;1-8.
 113. At-Tasneem MA, Azam WM, Jamaludin U. A study on the effect of flow rate on the power generated by a Pico hydro power turbine. World Applied Sciences Journal. 2014;30:420-423.
 114. Jintao L, Shuhong L, Yulin W, Lei J, Leqin W, Yuekun S. Numerical investigation of the hump characteristic of a pump – Turbine Based on an Improved Cavitation Model. Computers & Fluids. 2012;68:105-111.
 115. Rajput RK. Heat and mass transfer (S. I. units), 6th revised edition, 352-371. S. Chand and Company PVT limited, Ram Nagar, New Delhi; 2015.
 116. Gatte MT, Kadhim RA. Hydro power, in energy conservation. Ahmed AZ. (Ed.), In Tech Janeza Trdine 9, 51000 Rijeka, Croatia. 2012; 95–124. Available:www.intechopen.com
 117. Kunwor A. Technical specifications of micro hydro systems design and its implementation: Feasibility analysis and design of Lamaya Khola micro hydro power plant. BSc. Thesis, Arcada Polytechnic; 2012.
 118. ESHA. Small Hydropower energy efficiency campaign action (SHERPA) - strategic study for the development of small hydro power (SHP) in the European Union. European Small Hydropower Association; 2008. Available:<http://www.esha.be/>
 119. Harvey A, Brown A, Hettiarachi P, Inversin A. Micro hydro design manual: A guide to small-scale water power schemes. Intermediate Technology Publications; 1993.
 120. Derakhshan S, Kasaeian N. Optimal design of axial hydro turbine for micro hydropower plants, 26th IAHR Symposium on Hydraulic Machinery and Systems. IOP Conf. Series: Earth and Environmental Science. 2012;15.
 121. Chitrakar P. Micro-hydropower design aids manual. Kathmandu: Small Hydropower Promotion Project (SHPP/GTZ) and Mini-Grid Support Programme (MGSP/AEPC-ESAP), Nepal; 2004.
 122. Smith N, Ranjitkar G. Nepal case study - Pico hydro for rural electrification; 2000. Available:<http://www.eee.nottingham.ac.uk/picohydro/documents.html>
 123. Smith N, Ranjitkar G. Nepal case study– part one: Installation and performance of the Pico power pack. Pico Hydro Newsletter; 2000.
 124. Simpson R, Williams A. Design of propeller turbines for Pico hydro. 2011;(Version 1.1c). Available:www.picohydro.org.uk
 125. Maher P, Smith N. Pico hydro for village power - a practical manual for schemes up to 5kW in hilly areas. Micro Hydro Centre, Nottingham University; 2001. Available:www.eee.nottingham.ac.uk
 126. Maher P, Smith N, Williams A. Assessment of Pico hydro as an option for off grid electrification in Kenya. Renewable Energy. 2003;28:1369-1369.
 127. Maher P. Design and implementation of a 2.2 kW Pico hydro serving 110

- households. Micro Hydro Centre – Nottingham Trent University; 2002. Available:<http://www.eee.nottingham.ac.uk/picohydro/documents.html>
128. Ho-Yan B. Design of a low head Pico hydro turbine for rural electrification in Cameroon. Thesis Presented to The University of Guelph, Canada; 2012. Available:<https://dspace.lib.uoguelph.ca/xmlui/handle/10214/3552>
 129. RETScreen. Clean energy project analysis engineering & cases textbook: Small hydro project analysis. CANMET Energy Technology Centre–Varenes in Collaboration with NASA, UNEP & GEF; 2004. Available:<http://www.retscreen.net/>
 130. Ajuwape T, Ismail OS. Design and construction of a 5 kW turbine for a proposed micro hydroelectric power plant installation at Awba Dam University of Ibadan. *International Journal of Electrical and Power Engineering*. 2011;5(3):131–138.
 131. Sangal S, Garg A, Kumar D. Review of optimal selection of turbines for hydroelectric projects. *International Journal of Emerging Technology and Advanced Engineering*. 2013;3(3):424–430.
 132. Kaunda CS, Kimambo CZ, Nielsen TK. Hydropower in the context of sustainable energy supply: A review of technologies and challenges. *ISRN Renewable Energy*; 2012.
 133. Singh P, Nestmann F. Experimental optimization of a free vortex propeller runner for micro hydro application. *Experimental Thermal and Fluid Science*. 2009;33(6):991-1002.
 134. Singh P, Nestmann F. An optimization routine on a prediction and selection model for the turbine operation of centrifugal pumps. *Experimental Thermal and Fluid Science*. 2010;34:152–164.
 135. Yang S, Derakhshan S, Kong F. Theoretical, numerical and experimental prediction of pump as turbine performance. *Renewable Energy*. 2012;48:507-513.
 136. Yassi Y, Hasemloo S. Improvement of the efficiency of a new micro hydro turbine at part loads due to installing guide vane mechanism. *Energy Conversion and Management*. 2010;51(10):970-1975.
 137. Cobb BR, Sharp KV. Impulse turbine performance characteristics and their impact on Pico-hydro installations. *Renewable Energy*. 2013;50:959-964.
 138. Cobb BR. Experimental study of impulse turbines and permanent magnet alternators for Pico-hydropower Generation. Master Degree Thesis, Dept. of Mech. Engineering, Oregon State University; 2011.
 139. Katre SS, Bapat VN. Review of literature on induction generators and controllers for Pico hydro applications. *International Journal of Innovations in Engineering Research and Technology*. 2014;1(1):1-9.
 140. Lajqi S, Lajqi N, Hamidi B. Design and construction of mini hydropower plant with propeller turbine. *International Journal of Contemporary Energy*. 2016;2(1):1-13.
 141. Pacayra N, Sabate C, Villalon A. Assessment of streams in Oras, eastern samar: A basis for the design of pico-hydro projects and potential site for installation. *Imperial Journal of Interdisciplinary Research*. 2016;2(12):1083-1088.
 142. Park JH, Lee NJ, Wata JV, Hwang YC, Kim YT, Lee YH. Analysis of a Pico hydro turbine performance by runner blade shape using CFD. 26th IAHR Symposium on Hydraulic Machinery and Systems IOP Publishing IOP Conf. Series: Earth and Environmental Science. 2012;15.
 143. Ramos HM, Kenov KN, Pillet B. Stormwater storage pond configuration for hydropower solutions: Adaptation and optimization. *J. of Sustainable Development*. 2012;5(8):27–42.
 144. Vicente S, Bludszweit H. Flexible design of a Pico-hydropower system for Laos Communities. *Renewable Energy*. 2012; 44:406-413.
 145. Wang L, Wei D. The optimum structural design for spiral case in hydraulic turbine. *Procedia Engineering Advances in Control Engineering and Information Science*. 2011;15:4874–4879.
 146. Singh P, Nestmann F. Internal hydraulic analysis of impeller rounding in centrifugal pumps as turbines. *Experimental Thermal and Fluid Science*. 2011;35:121–134.
 147. Singh P, Nestmann F. Experimental investigation of the influence of blade height and blade number on the performance of low head axial flow turbines. *Renewable Energy*. 2011;36(1): 272-281.
 148. Williamson SJ, Stark BH, Booker JD. Low head Pico hydro turbine selection using a multi-criteria analysis. *Proc. of the World Renewable Energy Congress, Hydropower*

- Applications, Moshfegh B. (Ed.), Linköping, Sweden. 2011; 6:1377–1385.
149. Yadav G, Chauhan AK. Design and development of Pico micro hydro system by using household water supply. International Journal of Research in Engineering and Technology. 2014;3(10): 114-119.
150. Alnakhilani MM, Mukhtar DA, Himawanto AA, Danardono D. Effect of the bucket and nozzle dimension on the performance of a pelton water turbine. Modern Applied Science. 2015;9(1):25-33.
151. Chukwunkeke JI, Achebe Ch, Okolie Pc, Okwudibe Ha. Experimental investigation on the effect of head and bucket splitter angle on the power output of a pelton turbine. Int. Journal of Energy Engineering. 2014;4(4):81-87.

© 2018 Edeoja et al.; This is an Open Access article distributed under the terms of the Creative Commons Attribution License (<http://creativecommons.org/licenses/by/4.0>), which permits unrestricted use, distribution, and reproduction in any medium, provided the original work is properly cited.

Peer-review history:
The peer review history for this paper can be accessed here:
<http://www.sciencedomain.org/review-history/24667>